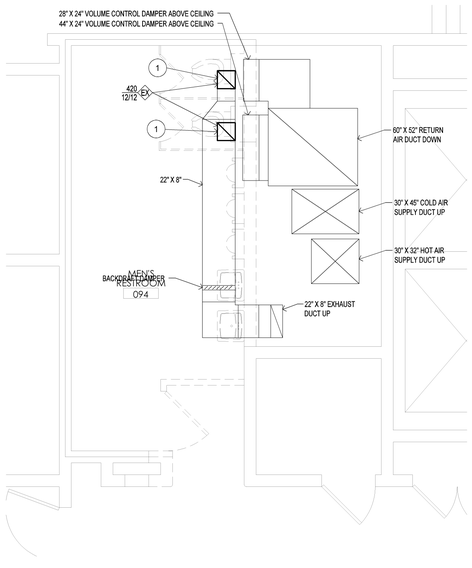

NOTE: WORK IN THIS PLAN SHALL ONLY BE PREFORMED UNDER ALTERNATE #4

ENLARGED BASEMENT RESTROOM PLAN - HVAC DEMOLITION

SCALE: 1/4" = 1'-0"

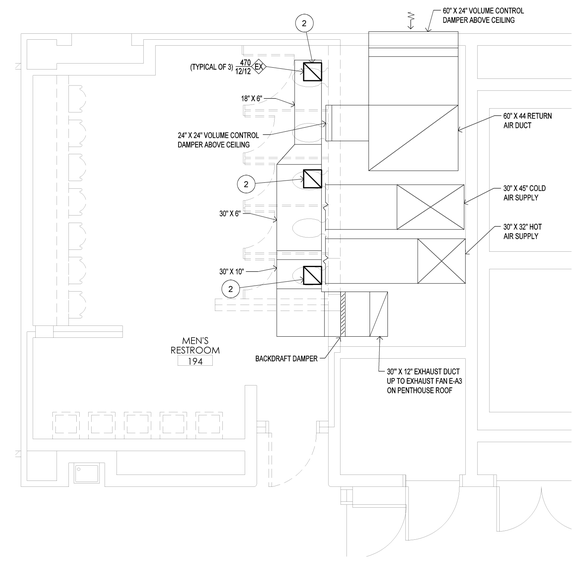

NOTE: WORK IN THIS PLAN SHALL ONLY BE PREFORMED UNDER ALTERNATE #3

ENLARGED FIRST FLOOR RESTROOM PLAN - HVAC DEMOLITION

SCALE: 1/4" = 1'-0"

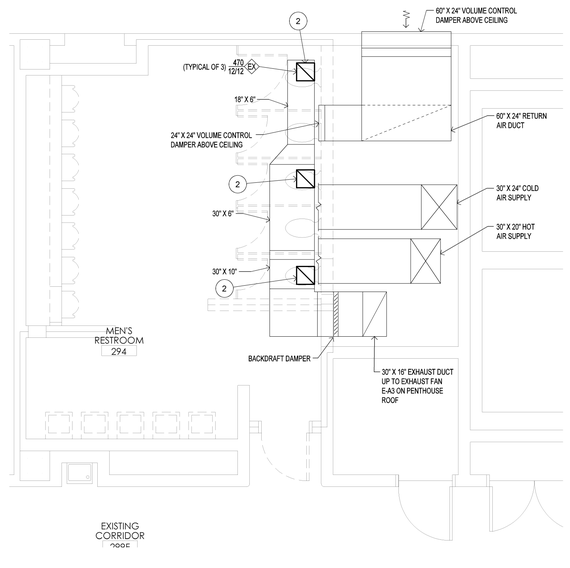

NOTE: WORK IN THIS PLAN SHALL ONLY BE PREFORMED UNDER ALTERNATE #2

ENLARGED SECOND FLOOR RESTROOM PLAN - HVAC DEMOLITION

SCALE: 1/4" = 1'-0"

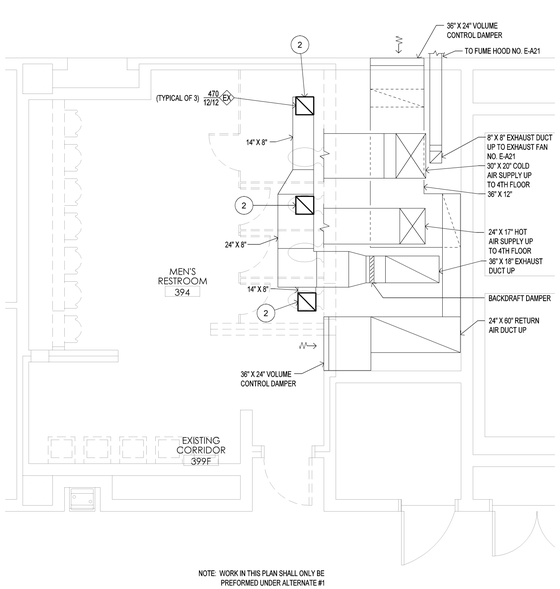

NOTE: WORK IN THIS PLAN SHALL ONLY BE PREFORMED UNDER ALTERNATE #1

ENLARGED THIRD FLOOR RESTROOM PLAN - HVAC DEMOLITION

SCALE: 1/4" = 1'-0"

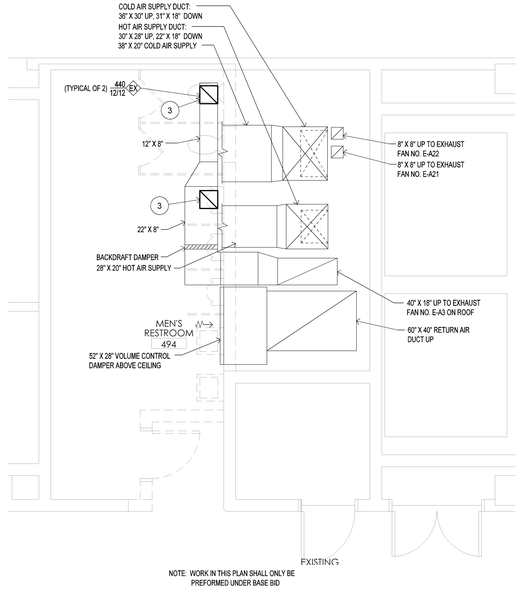

NOTE: WORK IN THIS PLAN SHALL ONLY BE PREFORMED UNDER BASE BID

ENLARGED FOURTH FLOOR RESTROOM PLAN - HVAC DEMOLITION

SCALE: 1/4" = 1'-0"

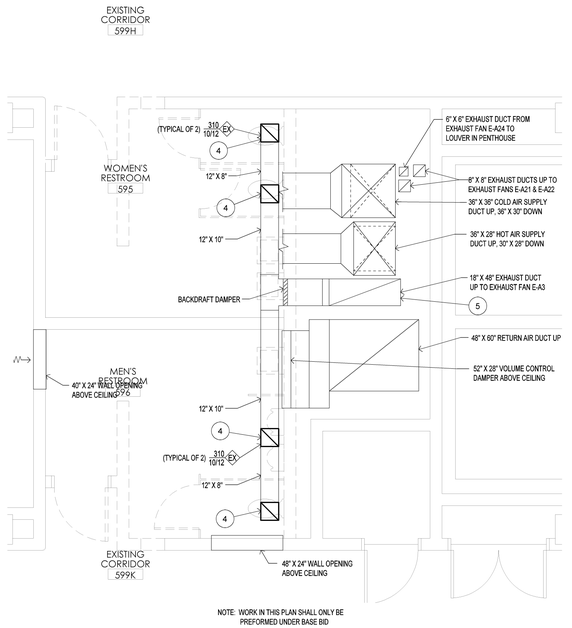

NOTE: WORK IN THIS PLAN SHALL ONLY BE PREFORMED UNDER BASE BID

ENLARGED FIFTH FLOOR RESTROOM PLAN - HVAC DEMOLITION

SCALE: 1/4" = 1'-0"

PLAN NOTES:

1. REMOVE 12" X 12" EXHAUST GRILLE, 420 CFM, IN CEILING AND PREPARE BRANCH DUCT FOR NEW CONNECTION. SEE SHEET H202.
2. REMOVE 12" X 12" EXHAUST GRILLE, 470 CFM, IN CEILING AND PREPARE BRANCH DUCT FOR NEW CONNECTION. SEE SHEET H202.
3. REMOVE 12" X 12" EXHAUST GRILLE, 440 CFM, IN CEILING. PREPARE BRANCH DUCT FOR RECONNECTION. SEE SHEET H202.
4. REMOVE 10" X 12" EXHAUST GRILLE, 310 CFM, IN CEILING. PREPARE BRANCH DUCT FOR RECONNECTION. SEE SHEET H202.
5. REMOVE EXHAUST FAN EF-A3 SERVING TOILETS. REMOVE FAN FROM CURB. DISCONNECT DUCT AND POWER. PREPARE CURB FOR ADDITION OF CURB ADAPTER.

INFLUENCE
architecture + interiors

INFLUENCE, architecture + interiors, Ltd.
7932 Barlum Drive
Indianapolis, IN 46240
www.influence-ai.com

[p] 317.513.3620
[f] 317.454.0776

SEALS / SIGNATURES:

KERRY L. SMITH REGISTERED No. 60880301 STATE OF INDIANA PROFESSIONAL ENGINEER

CONSULTANTS:

Mechanical / Electrical/ Plumbing Engineer:

CIRCLE DESIGN GROUP, INC.
320 S. EAST STREET , STE. F , INDIANAPOLIS, IN 46227 , (317) 781-8200
HEATING, VENTILATION, AIR CONDITIONING, PLUMBING, FIRE PROTECTION, LIGHTING AND ELECTRICAL DESIGN CONSULTANTS

Structural Engineer:

Silver Creek Engineering, Inc.
7225 WOODLAND DRIVE, SUITE 200
INDIANAPOLIS, INDIANA 46278
(317) 297-5610
FAX (317) 297-2942
www.sceindy.com

PROJECT

IUPUI
INDIANA UNIVERSITY
PURDUE UNIVERSITY
INDIANAPOLIS

CAVANAUGH HALL

RESTROOM RENOVATION PHASE 2

425 University Boulevard
Indianapolis, IN 46202

PROJECT NUMBER
IU #20141189
CDG #13045A

DATE / ISSUE

02-18-15	95% CONSTRUCTION DOCUMENTS OWNER REVIEW ISSUE
03-13-15	CONSTRUCTION DOCUMENTS

SHEET NAME

ENLARGED RESTROOM PLANS - HVAC DEMOLITION
HVAC DEMOLITION

SHEET NUMBER

HD201

G:\Projects\13045\HD202.dwg, 5/15/2015 5:12:17 PM, Brian Fike